











CENTRALISED HEAT RECOVERY UNIT

APPLICATION

Whole-house heat recovery unit, suitable for vertical installation.

SPECIFICATION

Outer fan casing manufactured from powder coated galvanised sheet steel providing long lasting and robust construction. The unit is finished in white RAL 9010.

Internal structure manufactured from EPP (expanded polypropylene) providing reduced sound emissions and maximised air tightness and thermal insulation.

EC external rotor motors fitted as standard for energy saving. Provided with integral thermal protection, mounted on sealed for life ball bearings.

Backward curved centrifugal impeller dynamically balanced and directly driven by the motor to provide a smooth airflow through the unit.

Highly efficient counterflow heat exchanger to maximise thermal recovery.

FEATURES & BENEFITS

Ease of installation: fixing bracket supplied to hang the unit easily on the wall.

Simplified electric wiring: the unit is supplied pre-cabled.

Removable front panel for quick access to filters and heat exchanger.

ISO Coarse 60% (G4) filters easy removable for cleaning. The unit is also provided with the ISO ePM1 60% (F7) filter accessory at the intake side.

Integral automatic bypass for free cooling during the summer season.

Automatic anti-frost protection to prevent frost building up on the exhaust side of the heat exchanger.

Two drainage holes to meet climate requirement.

Left/right configuration of the unit for mounting flexibility.

Tested to the latest standards: units are tested in the TÜV Rheinland accredited internal laboratory according to the operating document IEC OD 2048 (level CTF1) for the IEC 60335-1 and IEC 60335-2-80 Standards, meaning accurate, up to date information on electrical safety, performance and noise level that can be relied upon.

Unit thermal efficiency, air-leakage and energy efficiency measured at indipendent laboratory BRE (UK). Designed and manufactured in accordance with EN60335-2-80 (Low Voltage Directive) and the EMC Directive (Electromagnetic Compatibility).

OPERATION


The unit is supplied with a multi-function LCD display (CTRL-DSP) for automatic control and convenience, providing:

- 3 speed settings (adjustable).
- Boost option.
- Holiday mode.
- Night mode.
- Weekly timer.
- Bypass setting.
- · Airflow balancing.
- Filter replacement and fan failure indicator.
- Working hour counter.
- Setting saving and loading.
- Suitable for remote ambient sensors (SEN-HY, SEN-PIR).
- ModBus interface.
- Connection to remote pre/post heating element.
- Connection to remote water coil for heating.
- Left or Right hand configuration (air connection).



CTRL-DSP (supplied as standard)

Example of a complete ventilation system

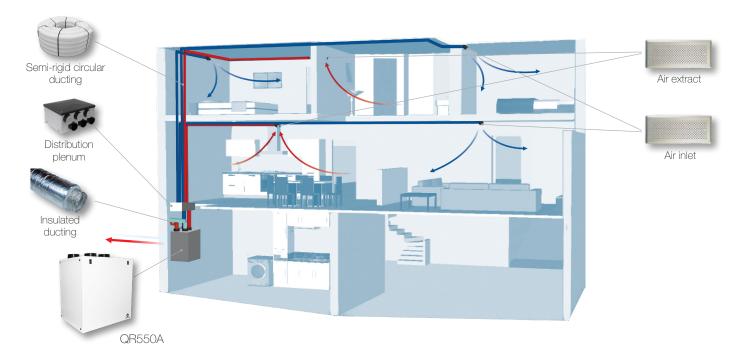


How it works: a continuous running heat recovery unit (QR550A) transfers heat from humid air extracted from wet rooms to warm incoming fresh air which is ducted to habitable rooms. Thanks to the easy-to-fit air distribution system each single ambient can be properly ventilate: the boost function enables rapid extract of increased moisture or pollutant levels. It also provides discrete installation and very quite operation.

Energy saving: the preheated/precooled fresh air and continuous air changes reduce the demand for additional heating/air-conditioning. The EC brushless motors significantly reduce the electricity consumption.

Indoor Air Quality: a correctly specified mechanical ventilation system can ensure the quality of the indoor air is constantly maintained for the health and well-being of the occupants as well as of the building. Duly maintained filters ensure that incoming air is suitably filtered of dust and pollen before if enters the home.


Dimensions (mm) and Weight (kg)

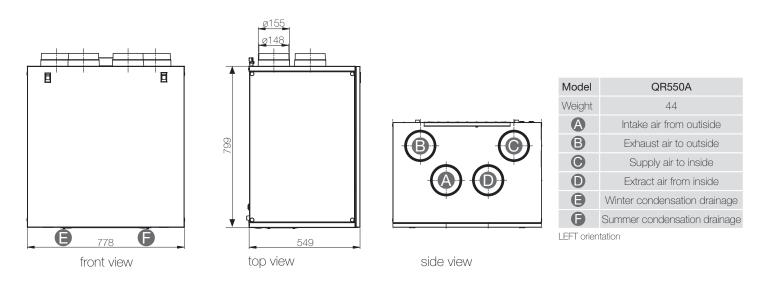

QR550A

Product fiche - ErP Directive, Regulations 1253/2014 - 1254/2014

b) Model c) SEC class c1) SEC warm climates c2) SEC average climates c3) SEC cold climates Energy label d) Unit typology e) Type of drive f) Type of Heat Recovery System g) Thermal efficiency of heat recovery h) Maximum flow rate @ 100 Pa i) Electric power input (maximum flow rate) j) Sound power level (L _{WA}) k) Reference flow rate l) Reference pressure difference	- kWh/m².a kWh/m².a kWh/m².a kWh/m².a	Varia	QR550A A -10,7 -34,4 -71,3 Yes ential - bidire able speed of				
c1) SEC warm climates c2) SEC average climates c3) SEC cold climates Energy label d) Unit typology e) Type of drive f) Type of Heat Recovery System g) Thermal efficiency of heat recovery h) Maximum flow rate @ 100 Pa i) Electric power input (maximum flow rate) j) Sound power level (L _{WA}) k) Reference flow rate	kWh/m².a kWh/m².a - - - - - - % m³/h W dBA	-15 -39,4 -77,4 Reside	-10,7 -34,4 -71,3 Yes ential - bidire	-6,7 -30,0 -66,1			
c2) SEC average climates c3) SEC cold climates Energy label d) Unit typology e) Type of drive f) Type of Heat Recovery System g) Thermal efficiency of heat recovery h) Maximum flow rate @ 100 Pa i) Electric power input (maximum flow rate) j) Sound power level (L _{WA}) k) Reference flow rate	kWh/m².a kWh/m².a - - - - - - % m³/h W dBA	-39,4 -77,4 Reside Varia	-34,4 -71,3 Yes ential - bidire able speed o	-30,0 -66,1			
c3) SEC cold climates Energy label d) Unit typology e) Type of drive f) Type of Heat Recovery System g) Thermal efficiency of heat recovery h) Maximum flow rate @ 100 Pa i) Electric power input (maximum flow rate) j) Sound power level (L _{WA}) k) Reference flow rate	kWh/m².a - - - - % m³/h W dBA	-77,4 Reside Varia	-71,3 Yes ential - bidire able speed (-66,1			
Energy label d) Unit typology e) Type of drive f) Type of Heat Recovery System g) Thermal efficiency of heat recovery h) Maximum flow rate @ 100 Pa i) Electric power input (maximum flow rate) j) Sound power level (L _{wa}) k) Reference flow rate	- - - - % m³/h W	Reside Varia	Yes ential - bidire able speed o	ectional			
d) Unit typology e) Type of drive f) Type of Heat Recovery System g) Thermal efficiency of heat recovery h) Maximum flow rate @ 100 Pa i) Electric power input (maximum flow rate) j) Sound power level (L _{wa}) k) Reference flow rate	m³/h W dBA	Varia	ential - bidire able speed o				
e) Type of drive f) Type of Heat Recovery System g) Thermal efficiency of heat recovery h) Maximum flow rate @ 100 Pa i) Electric power input (maximum flow rate) j) Sound power level (L _{WA}) k) Reference flow rate	m³/h W dBA	Varia	able speed o				
f) Type of Heat Recovery System g) Thermal efficiency of heat recovery h) Maximum flow rate @ 100 Pa i) Electric power input (maximum flow rate) j) Sound power level (L _{WA}) k) Reference flow rate	m³/h W dBA			drive			
g) Thermal efficiency of heat recovery h) Maximum flow rate @ 100 Pa i) Electric power input (maximum flow rate) j) Sound power level (L _{wA}) k) Reference flow rate	m³/h W dBA	H	leat recover				
h) Maximum flow rate @ 100 Pa i) Electric power input (maximum flow rate) j) Sound power level (L _{WA}) k) Reference flow rate	m³/h W dBA			У			
 i) Electric power input (maximum flow rate) j) Sound power level (L_{WA}) k) Reference flow rate 	W dBA		82				
j) Sound power level (L _{wA}) k) Reference flow rate	dBA		520				
k) Reference flow rate		333					
	m3/h	58					
Reference pressure difference	m³/h	364					
,	Pa	50					
m) Specific power input (SPI)	W/m³/h	0,412					
n1) Control factor	-	0,65	0,85	1,0			
n2) Control typology	-	Local demand control	Central demand control	Manual control (no DCV)			
o1) Maximum internal leakage rate	%	0,8					
o2) Maximum external leakage rate	%	0,5					
p1) Internal mixing rate	%	N/A					
p2) External mixing rate	%	N/A					
q) Visual filter warning	-	Visual filter warning on display					
r) Instructions to install regulated grilles	-	N/A					
s) Internet address for pre/disassembly instructions	-	www.aerauliqa.com					
t) Airflow sensitivity to pressure variations	%	N/A					
u) Indoor/outdoor air tightness	m³/h						
v1) AEC - Annual electricity consumption - warm climates	kWh	2,2	3,7	5,2			
v2) AEC - Annual electricity consumption - average climate	es kWh	2,6	4,2	5,6			
v3) AEC - Annual electricity consumption - cold climates	kWh	8,0	9,6	11,0			
w1) AHS - Annual heating saved - warm climates	kWh	20,5	20,0	19,6			
w2) AHS - Annual heating saved - average climates	kWh	45,3	44,2	43,4			
w3) AHS - Annual heating saved - cold climates	kWh	kWh 88,7 86		84,8			
Sound pressure @ 3m ⁽¹⁾	dB(A)		34				
Ambient temperature max	°C		+40				
Degree of protection IP	_	X4					
Marking			X4				

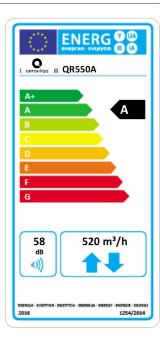


 ²²⁰⁻²⁴⁰V ~ 50/60Hz

⁻ air performance measured according to ISO 5801 a 230V 50Hz, air density 1,2 Kg/m³.

data measured in the TÜV Rheinland accredited internal laboratory according to the operating document IEC OD 2048 (level CTF1) for the IEC 60335-1 and IEC 60335-2-80 Standards.

⁽¹⁾ sound pressure level @ 3m in free field, breakout, speed 40%, for comparative purposes only.

Performance curve

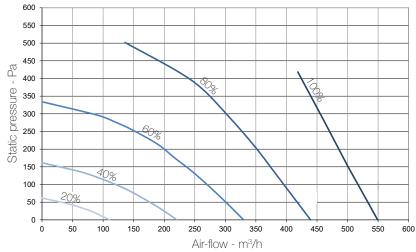

Speed %	W max	m³/h max
20	17	110
40	44	221
60	110	330
80	264	440
100	333	550

Intake curve according to Reg. 1253/2014 (ErP).
Product tested without F7 filter.

Sound level

Extract

Exhaust

Breakout

		Lw dB - SOUND POWER OCTAVE BAND								Lp dB(A)	
	Speed 100%	63	125	250	500	1 K	2 K	4 K	8K	Tot	@3m
Intake	•	83	65	70	73	62	58	53	47	84	51
Supply		81	65	65	66	57	51	42	33	81	45
Extract		80	63	66	68	60	54	45	34	78	47
Exhaust		78	65	70	71	62	59	53	45	80	50
Breakout		81	69	67	69	62	56	48	36	82	48
		Lw dB - SOUND POWER OCTAVE BAND								L = -ID(A)	
											Lp dB(A)
	Speed 80%	63	125	250	500	1 K	2 K	4 K	8K	Tot	@3m
Intake		73	61	67	69	59	56	50	43	75	47
Supply		72	61	63	65	56	50	41	31	74	43
Extract		73	60	63	65	57	51	42	31	74	44
Exhaust		73	61	66	67	58	55	49	41	75	46
Breakout		71	64	62	67	59	53	45	33	74	45
		Lw dB - SOUND POWER OCTAVE BAND								Lp dB(A)	
	Speed 60%	63	125	250	500	1 K	2 K	4 K	8K	Tot	@3m
Intake		65	61	68	67	58	56	49	41	72	46
Supply		63	59	63	64	55	49	40	29	69	42
Extract		64	59	63	63	56	51	41	30	69	42
Exhaust		64	60	66	67	57	54	48	41	71	45
Breakout		59	64	63	65	57	51	43	31	70	44
		Lw dB - SOUND POWER OCTAVE BAND							Lp dB(A)		
	Speed 40%	63	125	250	500	1 K	2 K	4 K	8K	Tot	@3m
Intake		55	55	67	55	49	47	40	31	68	39
Supply		53	53	62	52	47	41	32	22	63	35

54 53